


NOTES:

- 1.) The Two-Way Cleanout and Riser Assembly shall be SDR-35 PVC, Schedule 40 PVC, or as directed by BASA. The sizes required will be as directed by BASA and will be dependant on the existing piping arrangements encountered at the time of installation.
- 2.) Regardless of the piping arrangements encountered, the Contractor will be required to furnish and install all appropriate adapters, couplings and fittings to complete the installation in a manner that is acceptable to BASA. Where it is necessary to couple two pipes of different sizes, use only eccentric fittings to properly match the invert of both pipes being coupled together.
- 3.) BASA Approved Crushed Limestone: A.A.S.H.T.O. NO. 8, 57, OR 67 in the pipe zone of the building sewer and around all risers.



INSPECTION TEE

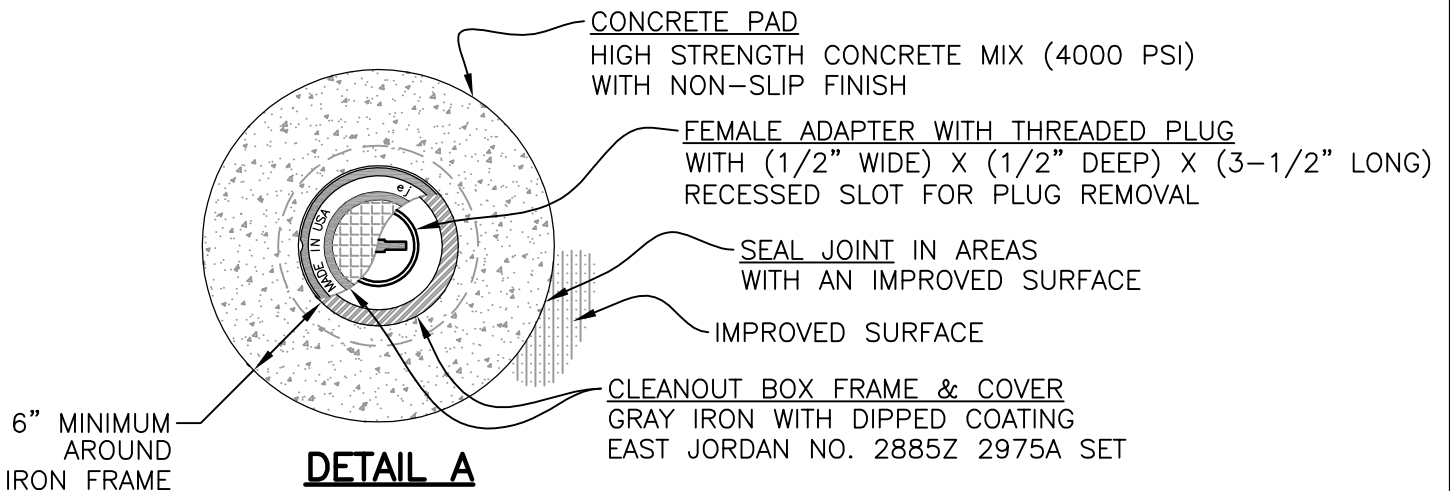

NOT TO SCALE

BUTLER AREA SEWER AUTHORITY

CREATED: DECEMBER 13, 2005
REVISED: MARCH 2, 2018

BASA DRAWING NO. 14